


BCR = BEGIN CURB RETURN
 ECR = END CURB RETURN
 TYP = TYPICAL
 MIN = MINIMUM



NOTES:

1. LOCATION OF WATER LINES AND VALVES SHALL BE SHOWN ON THE PROJECT PLANS.
2. HYDRANT TO BE SET PLUMB, WITH NOZZLE A MINIMUM OF EIGHTEEN (18") INCHES ABOVE GROUND LEVEL. WHEN HYDRANTS ARE PLACED BEFORE GRADING IS COMPLETED, THE FINAL GRADE LINE, AND ACCESSIBILITY SHOULD BE CONSIDERED.
3. NO OBSTRUCTIONS SUCH AS POLES, GUY LINES, ETC, SHOULD BE PLACED CLOSER THAN FIVE FEET (5') TO HYDRANT.
4. FOR SUBDIVISION IMPROVEMENT PLANS, SEE COUNTY HEALTH DEPARTMENT STANDARDS, SECTION 7, DISTRIBUTION SYSTEMS, FOR MINIMUM DEPTH.
5. FOR RECOMMENDED UTILITY LOCATION SEE STANDARD 311.
6. FOR RIGHT OF WAY LOCATION SEE PROJECT PLANS.
7. FOR CURB RETURN RADIUS AND SIDEWALK RAMP DETAILS SEE STANDARD 110.

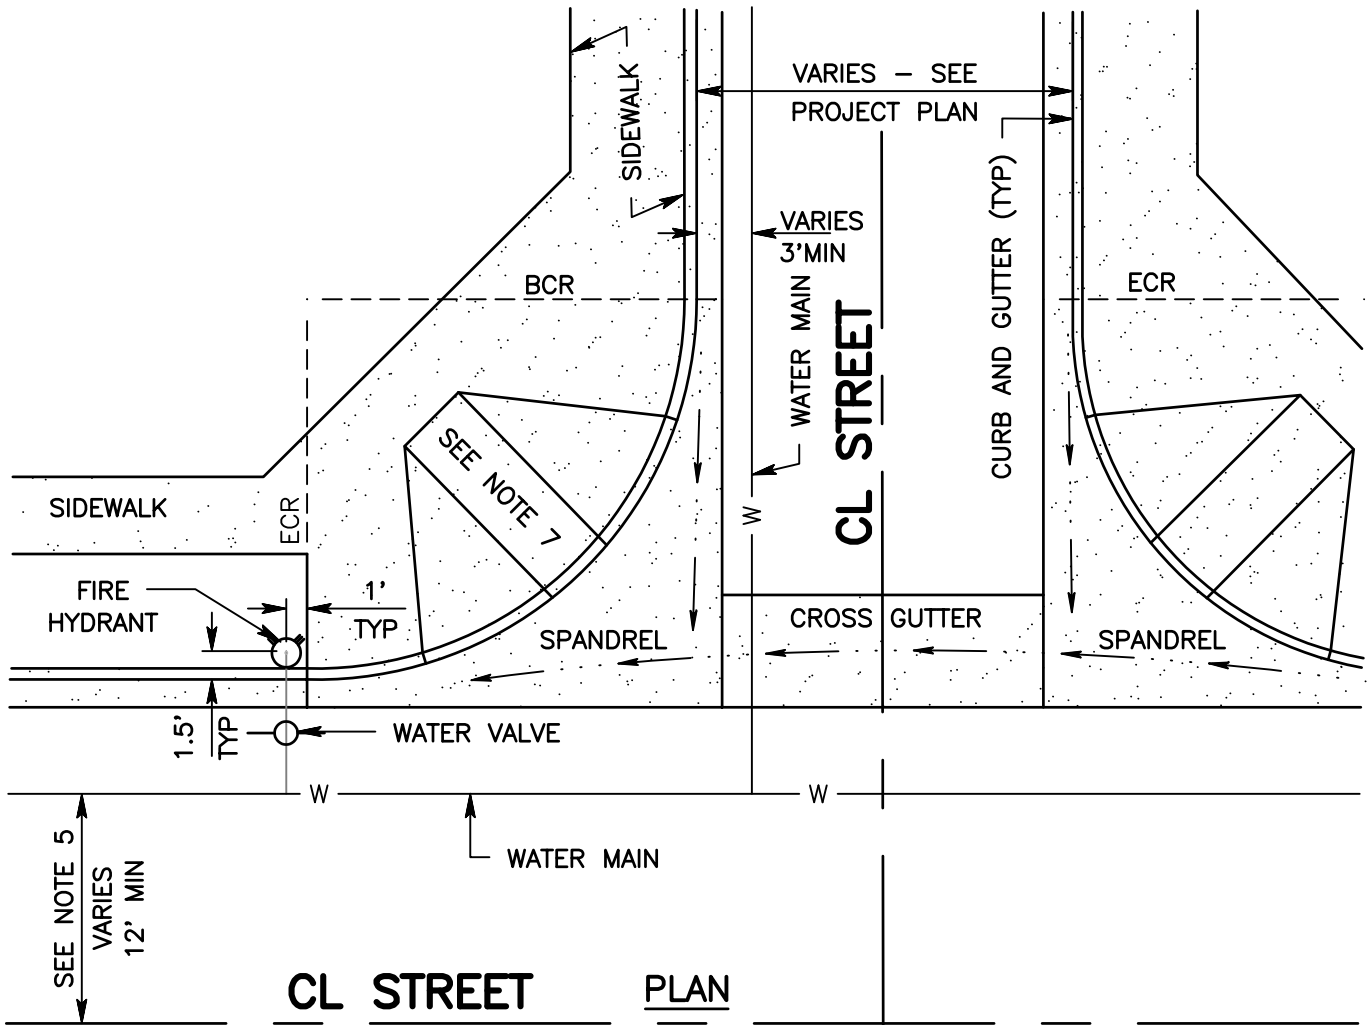

SAN BERNARDINO COUNTY DEPARTMENT OF PUBLIC WORKS

FIRE HYDRANT LOCATION

BRENDON P. BIGGS, PE
 DIRECTOR OF PUBLIC
 WORKS/ROAD
 COMMISSIONER